


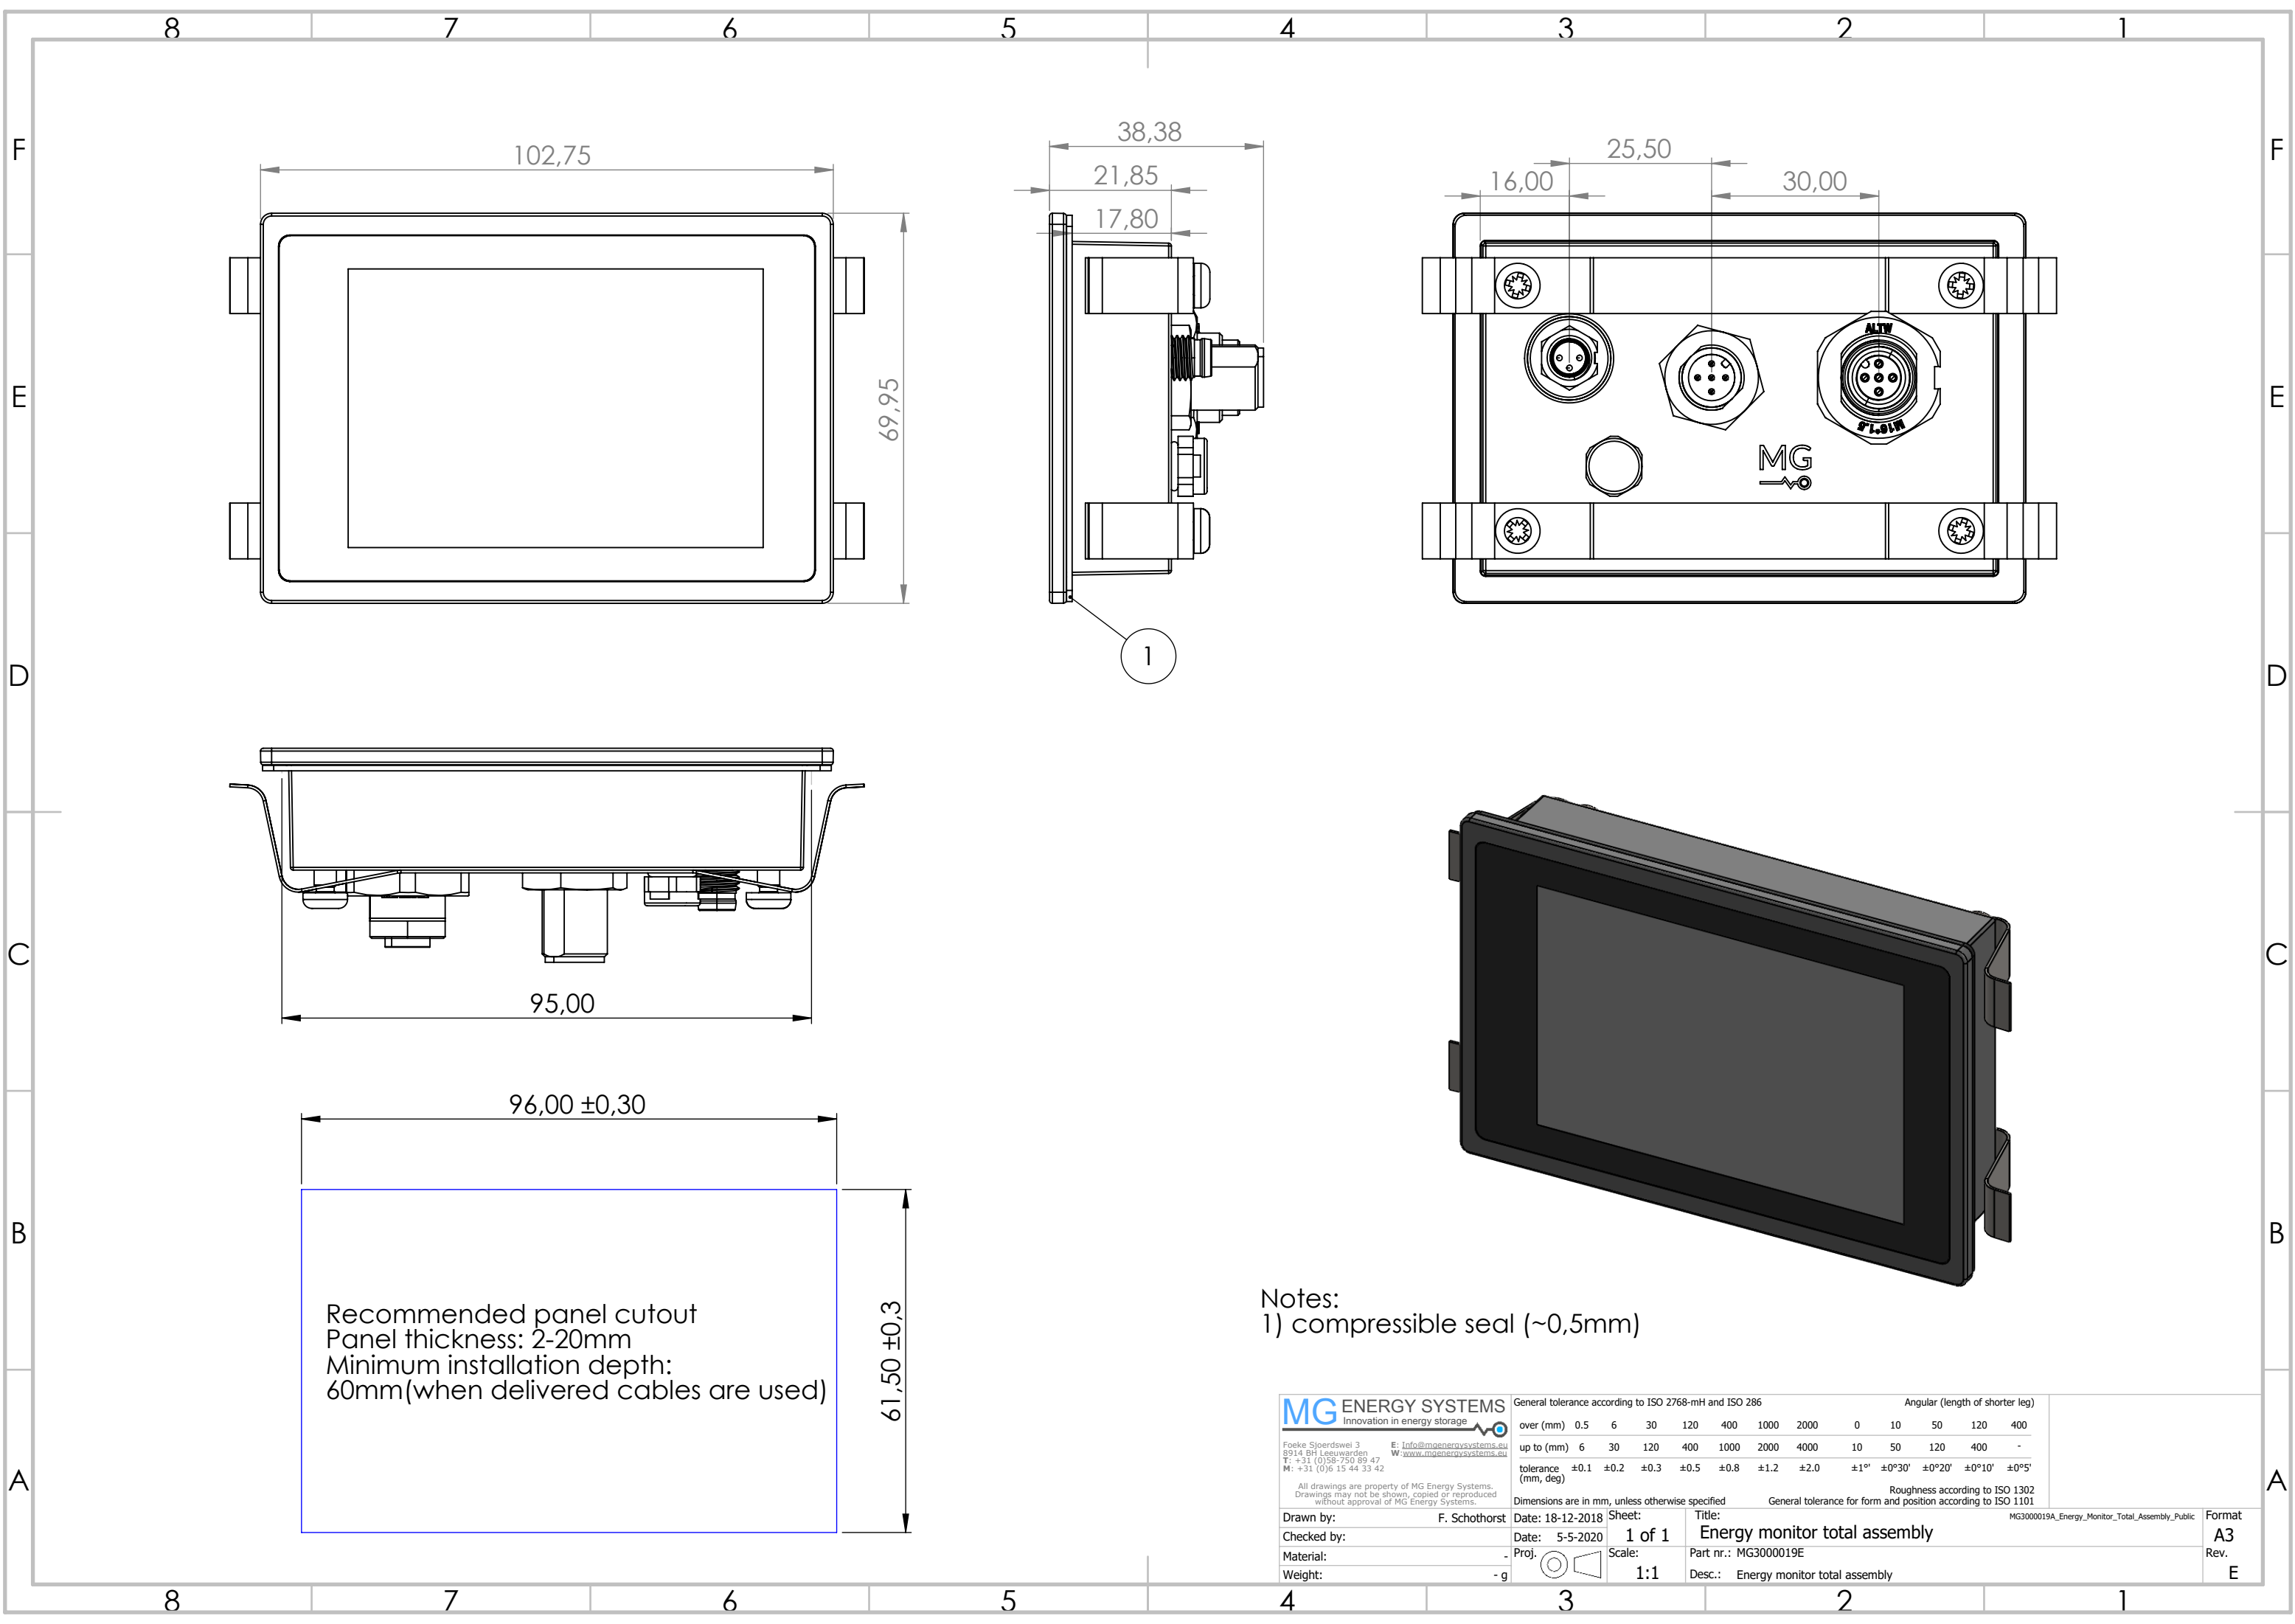

Recommended panel cutout
Panel thickness: 2-20mm
Minimum installation depth:
60mm(when delivered cables are used)

MG ENERGY SYSTEMS Innovation in energy storage Foeke Sjoerdsma 3 8914 BH Leeuwarden T: +31 (0)58-750 89 47 M: +31 (0)6 15 44 33 42 E: info@mgenergysystems.eu W: www.mgenergysystems.eu All drawings are property of MG Energy Systems. Drawings may not be shown, copied or reproduced without approval of MG Energy Systems.		General tolerance according to ISO 2768-mH and ISO 286										Angular (length of shorter leg)				
		over (mm)	0.5	6	30	120	400	1000	2000	0	10	50	120	400		
		up to (mm)	6	30	120	400	1000	2000	4000	10	50	120	400	-		
		tolerance (mm, deg)	±0.1	±0.2	±0.3	±0.5	±0.8	±1.2	±2.0	±1°	±0°30'	±0°20'	±0°10'	±0°5'		
		Roughness according to ISO 1302														
General tolerance for form and position according to ISO 1101																
Dimensions are in mm, unless otherwise specified																
Drawn by: F. Schotthorst		Date: 18-12-2018	Sheet: 1 of 1	Title: Energy monitor total assembly										MG3000019A_Energy_Monitor_Total_Assembly_Public		Format A3
Checked by:		Date: 5-5-2020	Proj.	Scale: Part nr.: MG3000019E										Rev.		
Material:				1:1										Desc.: Energy monitor total assembly		E
Weight: - g																